



CITY OF CAMBRIDGE
MASSACHUSETTS
Water Department
250 Fresh Pond Parkway
Cambridge, MA 02138
617 349 4770
fax 617 349 6616



August 1, 2011

JULY, 2011 WATER SUPPLY SUMMARY REPORT

Highlights

- Reporting period 7/1/11 - 8/1/11
- Hobbs, Stony, and Fresh Pond reservoirs are currently at 83%, 83%, 97%* capacity respectively. (*Based on total reservoir storage, not gross usable capacity)
- Measured July precipitation (1.7") is nearly half of Massachusetts NE region July normals (3.45")

Storage

Figure 1: Hobbs Brook Reservoir Storage, July 2011

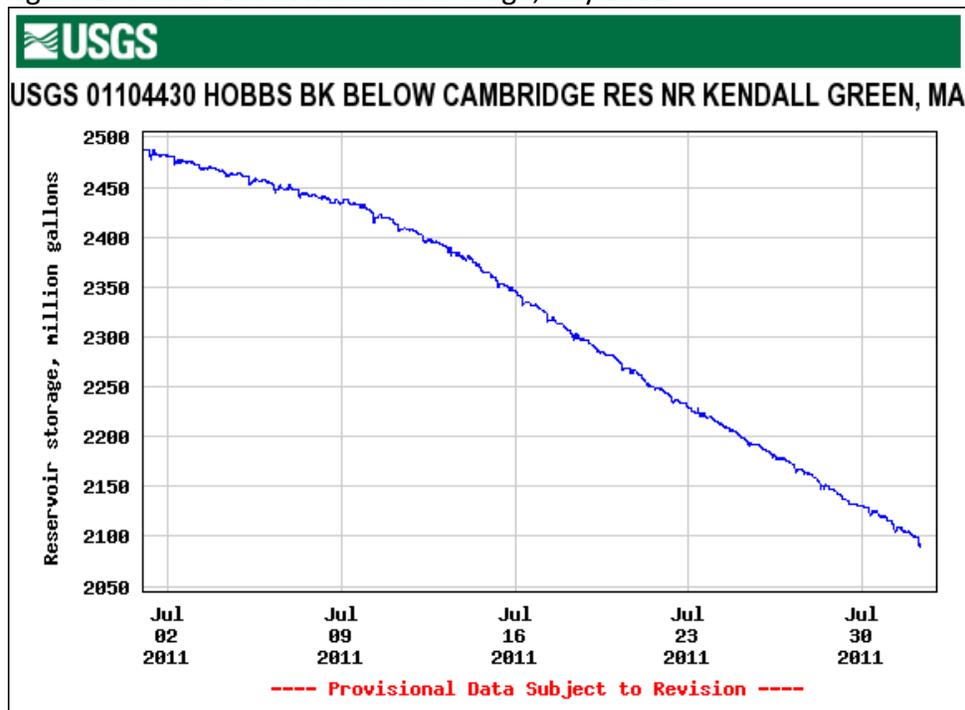


Figure 2. Stony Brook Reservoir Storage, July 2011



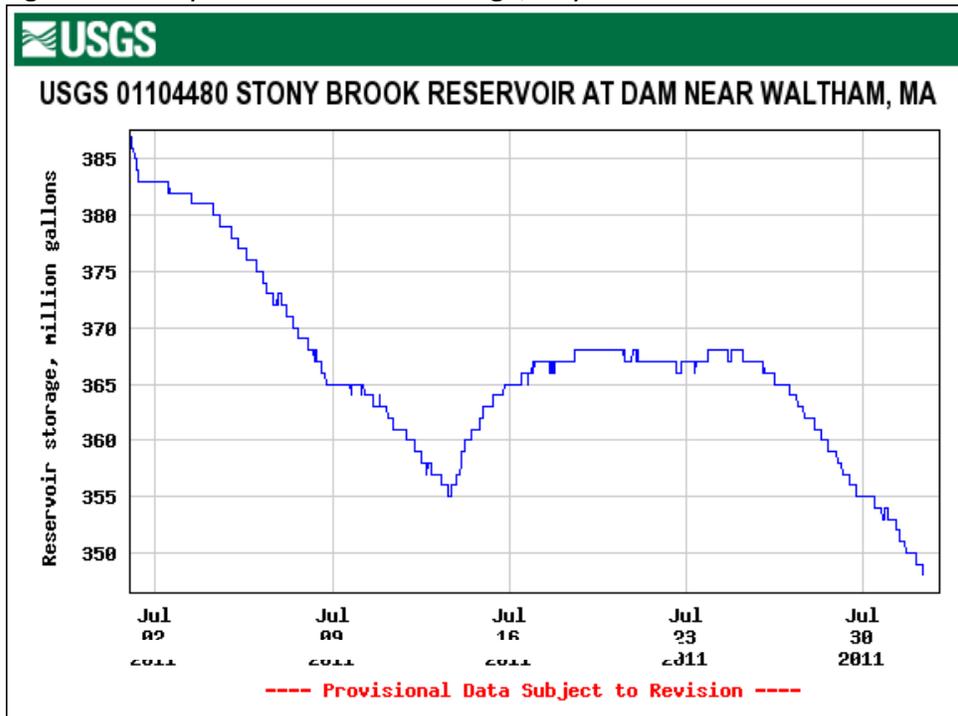


Figure 3. Fresh Pond Reservoir Storage, July 2011

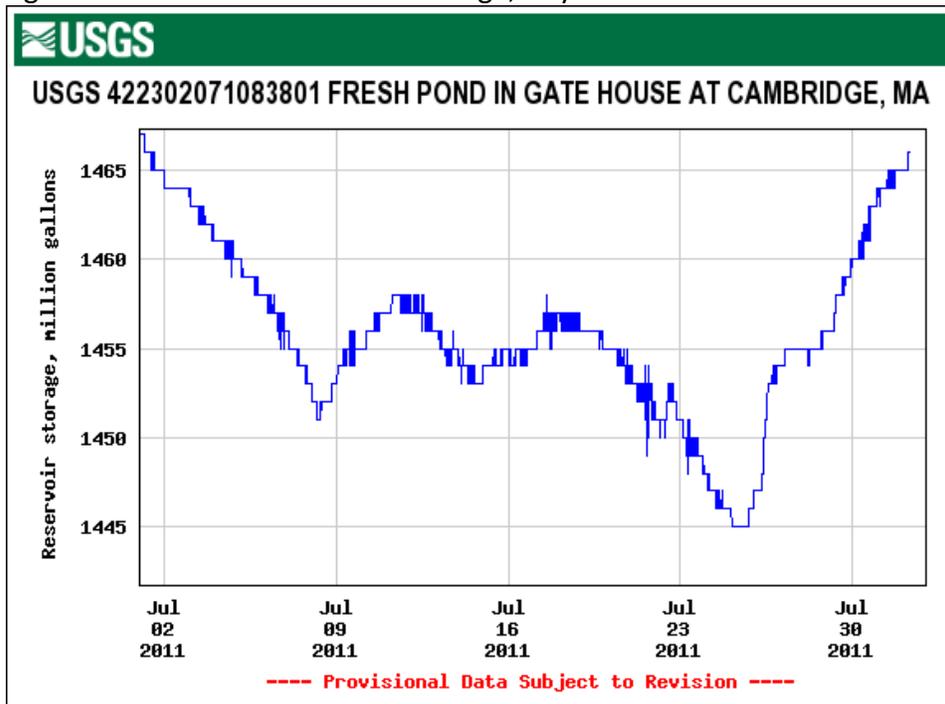

Precipitation

Figure 4. Precipitation at Hobbs Brook Reservoir, July 2011

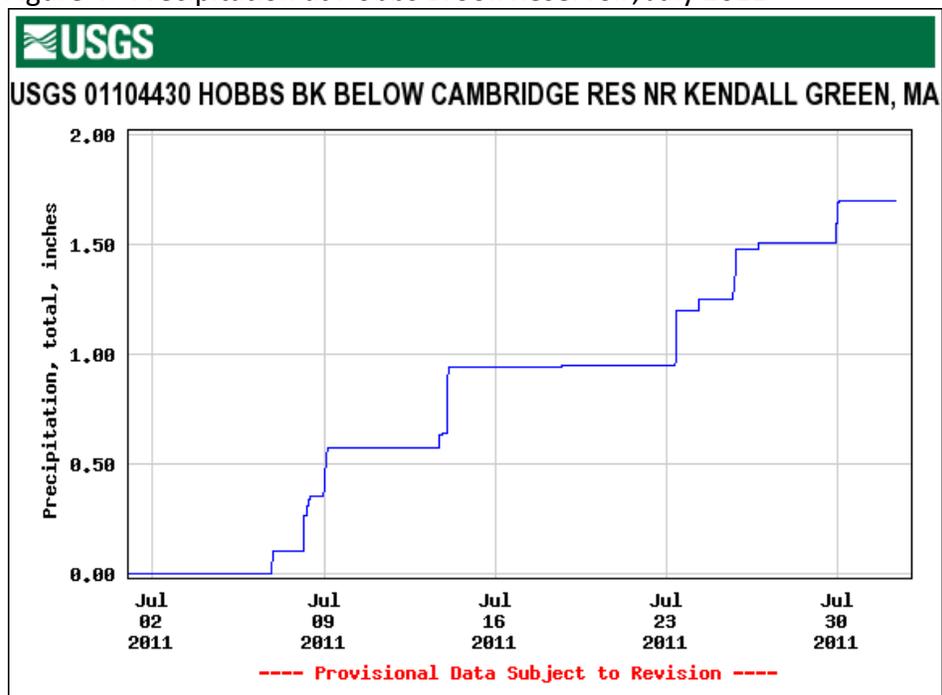

David Kaplan, Watershed Protection Supervisor

dkaplan@cambridgema.gov

617-349-4799

Real-time data available on the web at

http://waterdata.usgs.gov/ma/nwis/current?type=cambrid&group_key=NONE&search_site_no_station_nm=&format=html_table