



CITY OF CAMBRIDGE
MASSACHUSETTS
Water Department
250 Fresh Pond Parkway
Cambridge, MA 02138
617 349 4770
fax 617 349 6616



April 1, 2010

MARCH, 2010 WATER SUPPLY SUMMARY REPORT

Highlights

- Reporting period 3/1/10 - 4/1/10
- Hobbs, Stony and Fresh Pond are currently at 103%, 106%, 94%* capacity respectively. (*Based on total reservoir storage, not gross usable capacity)
- Measured March precipitation (**17.03"** at Hobbs Brook Dam) is **13"** more than Massachusetts NE region March normals (4.02").
- One layer of stoplogs removed from Hobbs Brook Dam after March 14-15 storm event

Storage

Figure 1: Hobbs Brook Reservoir Storage, March 2010

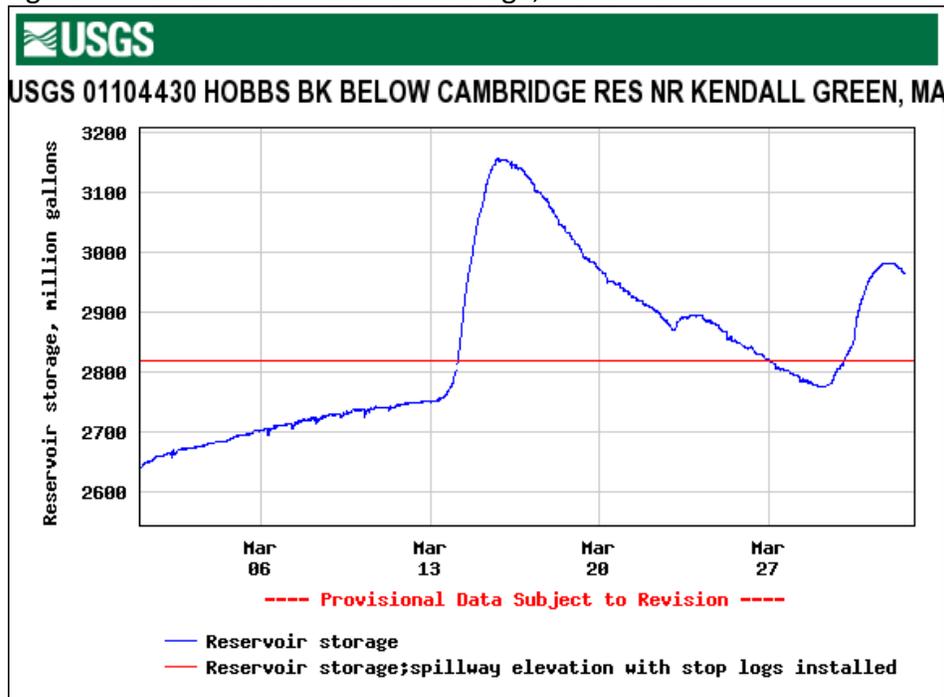


Figure 2. Stony Brook Reservoir Storage, March 2010



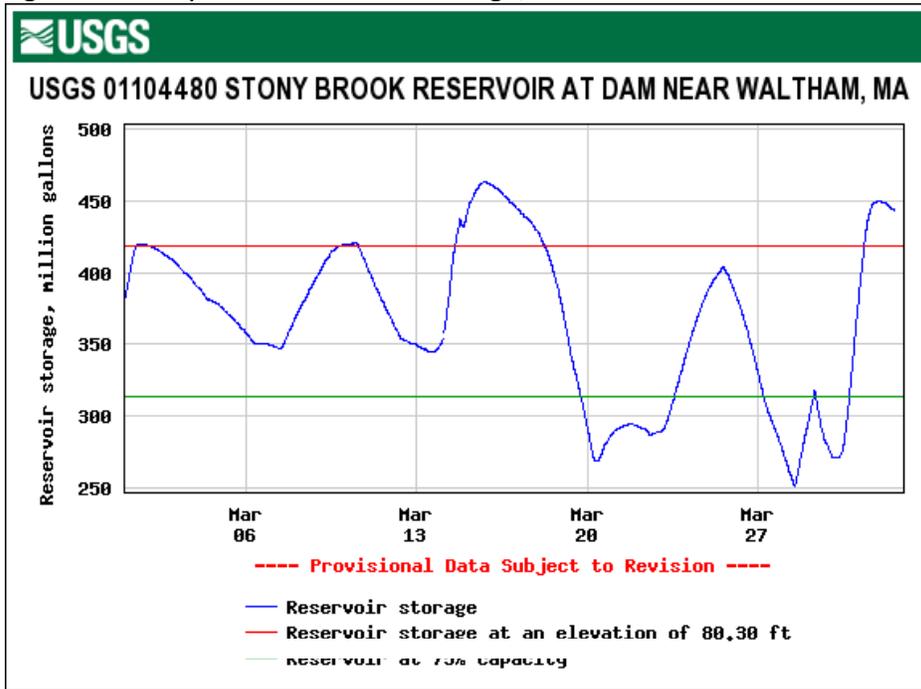


Figure 3. Fresh Pond Reservoir Storage, March 2010

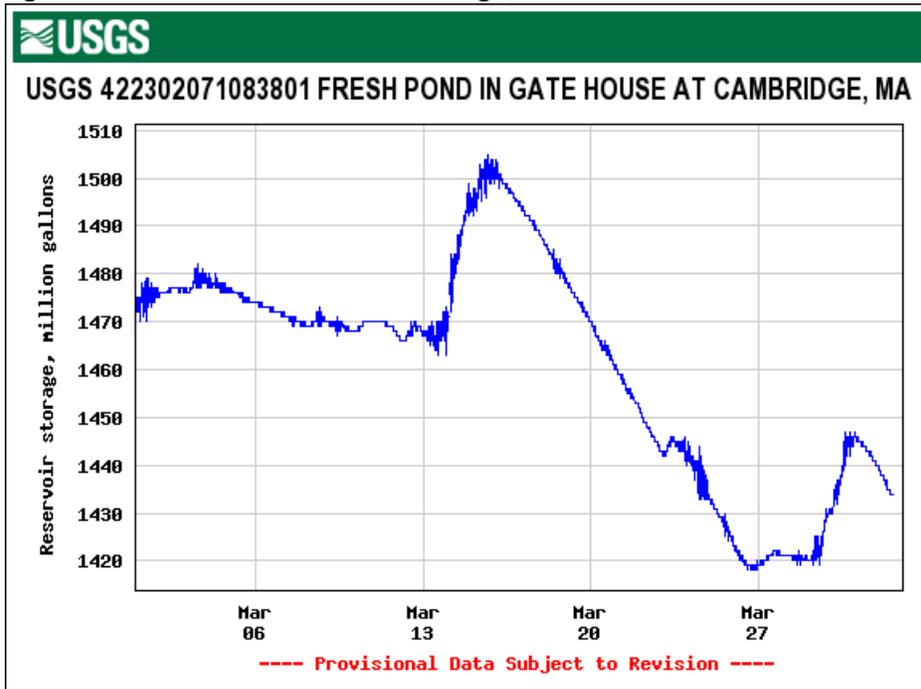

Precipitation

Figure 4. Rainfall at Hobbs Brook Reservoir, March 2010

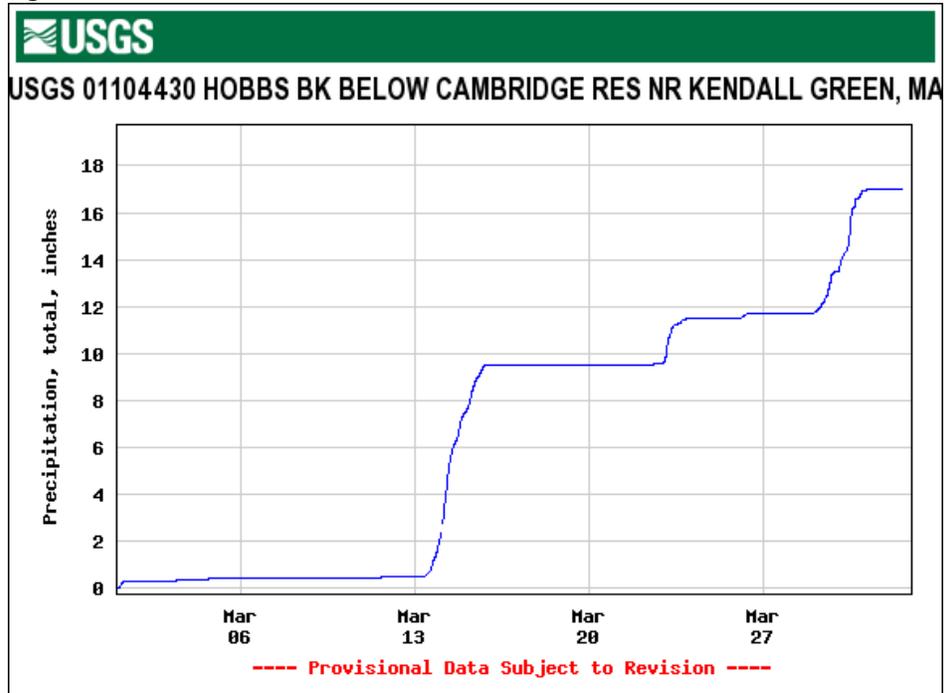

David Kaplan, Watershed Protection Supervisor

dkaplan@cambridgema.gov

617-349-4799

Real-time data available on the web at

http://waterdata.usgs.gov/ma/nwis/current?type=cambrid&group_key=NONE&search_site_no_station_nm=&format=html_table

March 14 - 15, 2010 Storm Event



March 30 - 31, 2010 Storm Event

